

FIG. 1

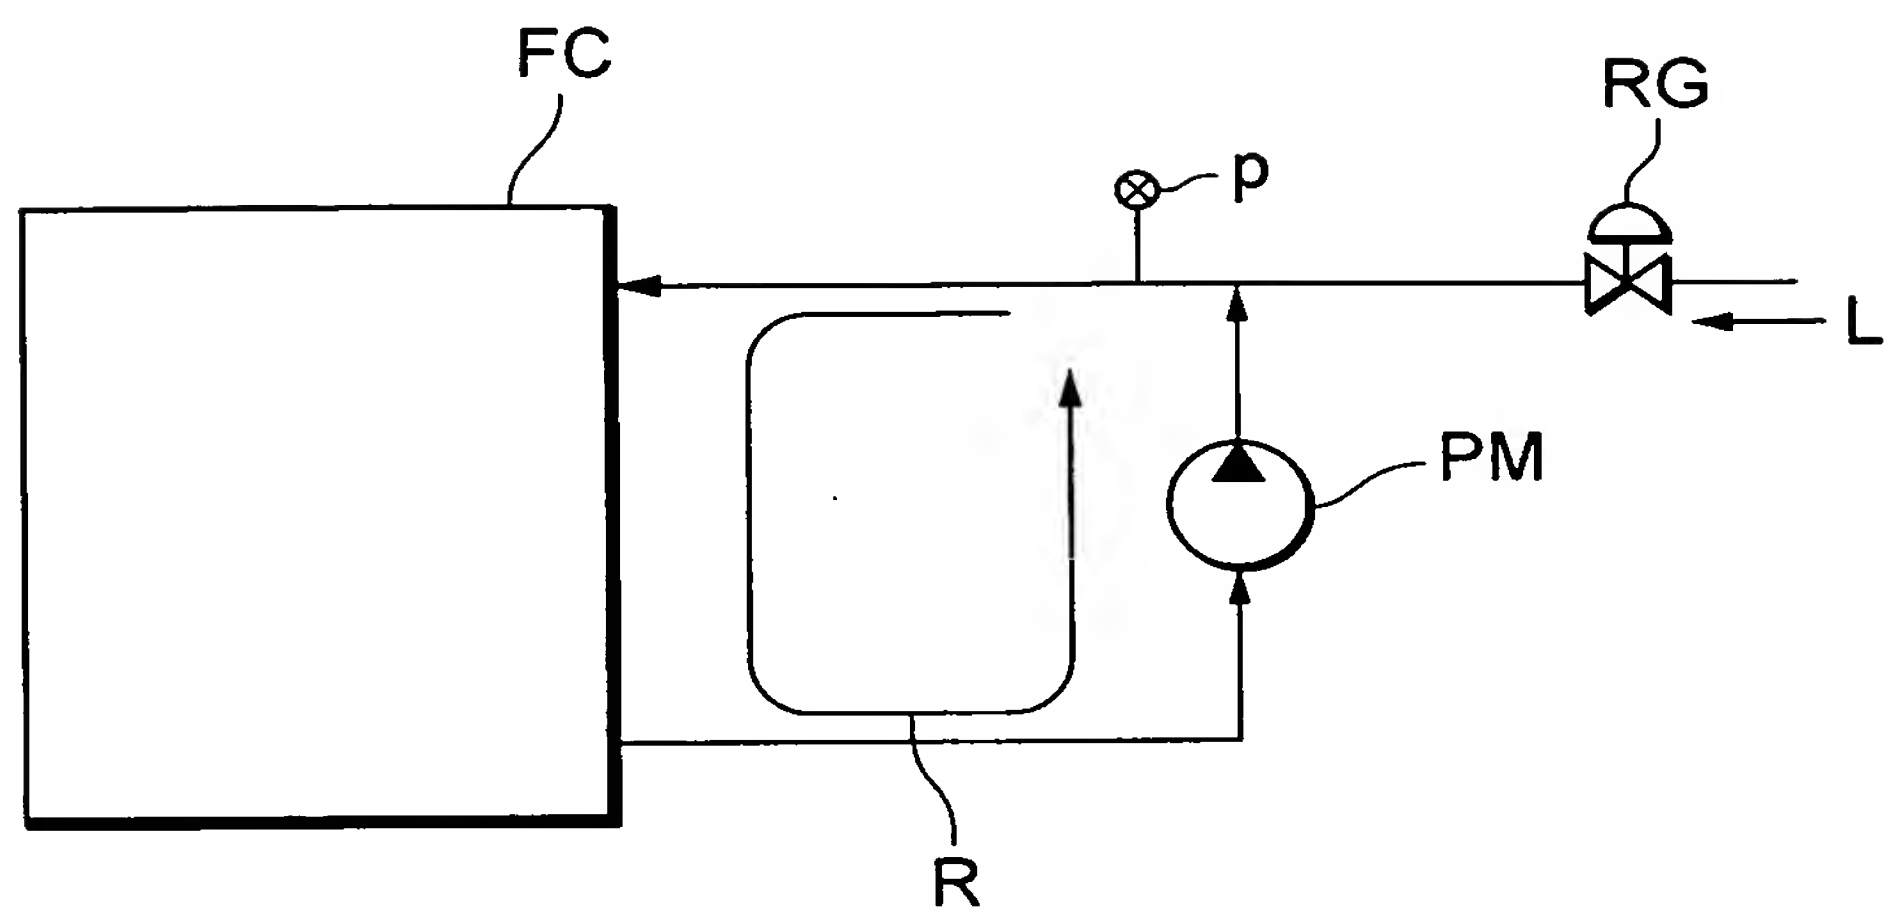
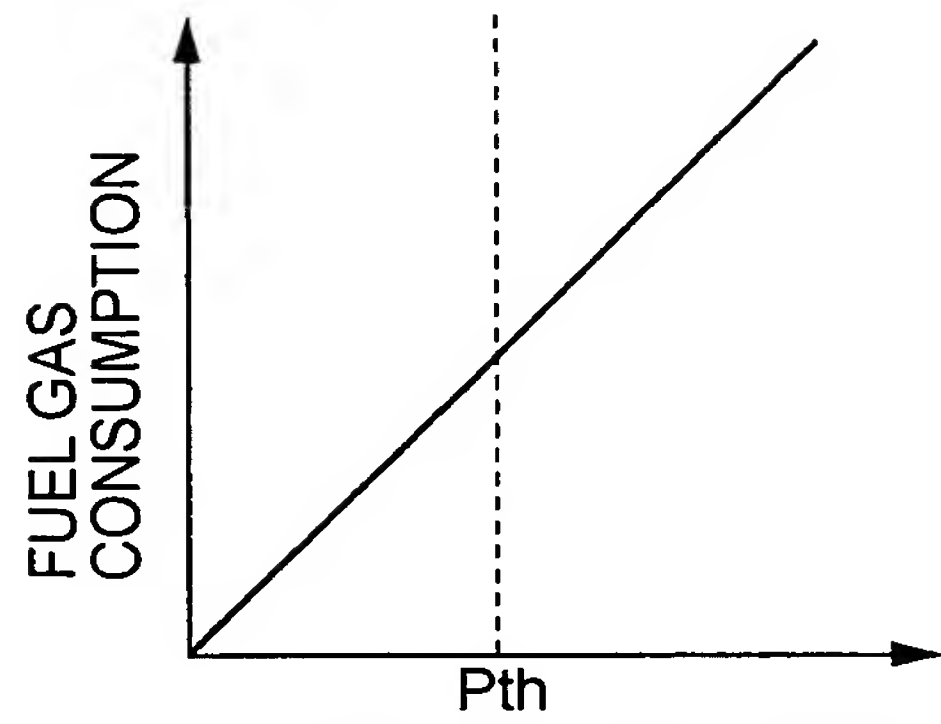
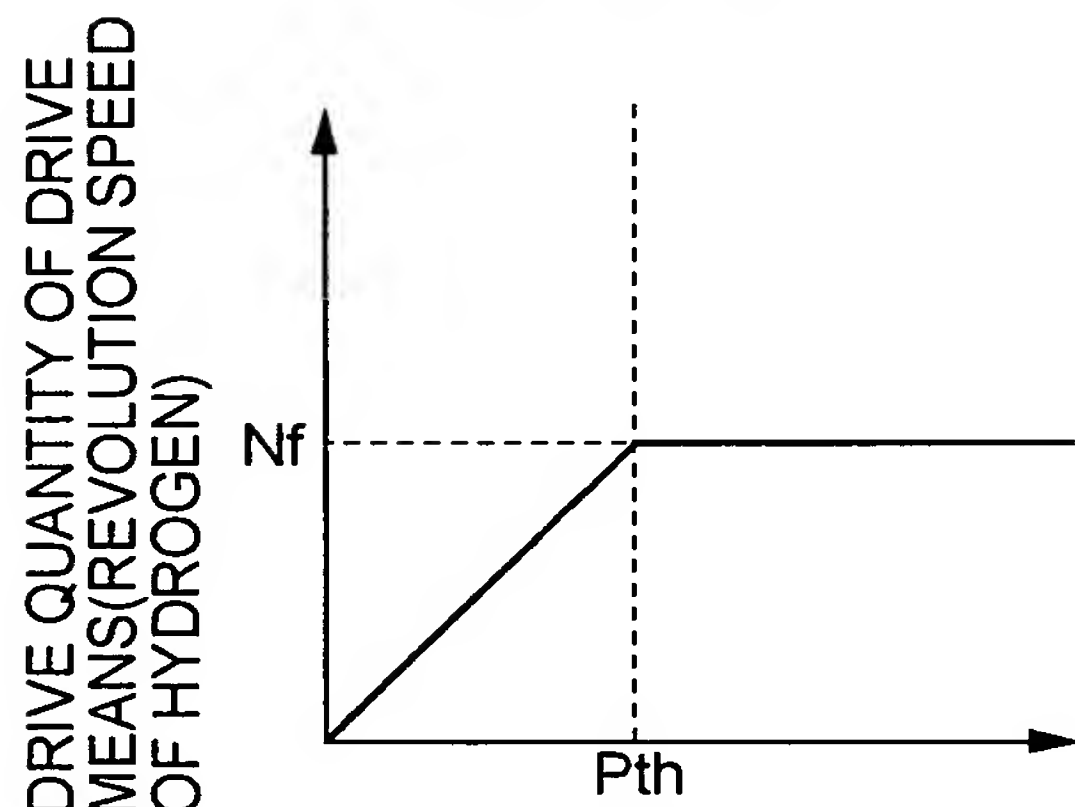
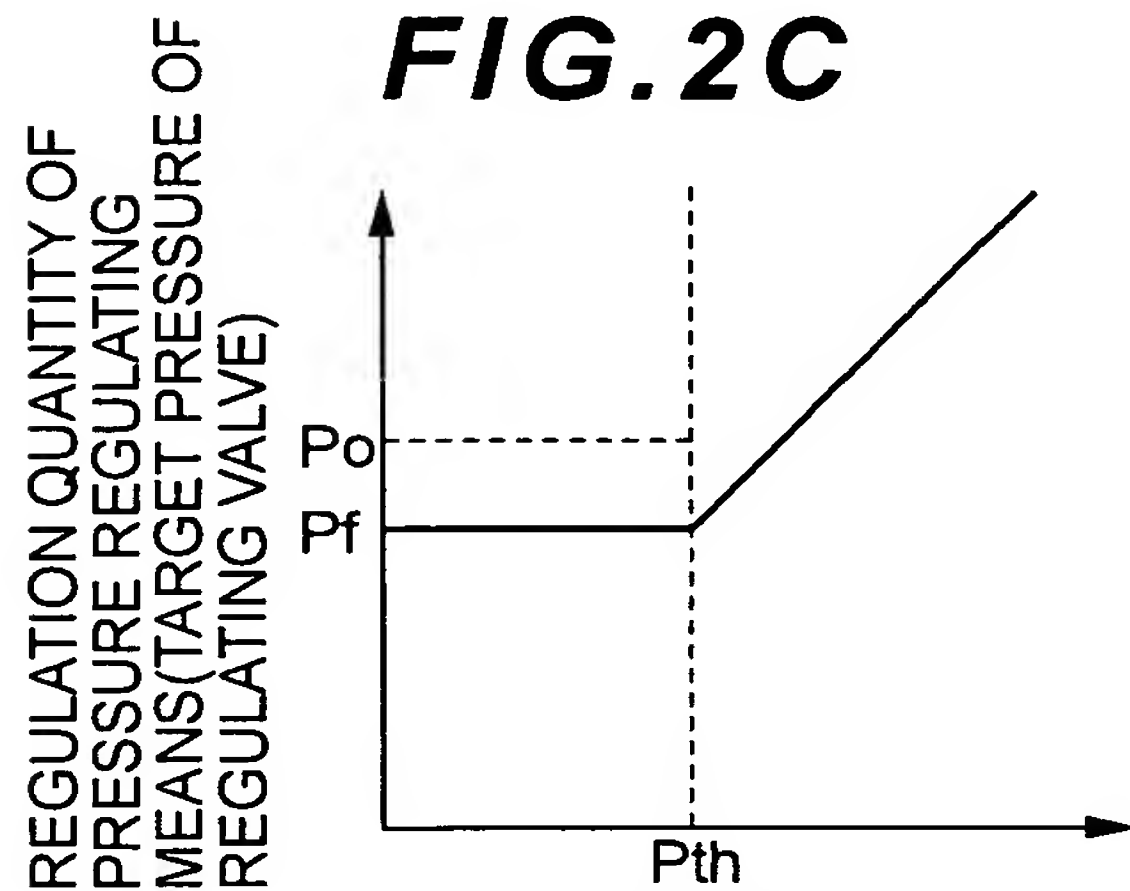


FIG. 2A

FC REQUIRED GENERATED
POWER QUANTITY
(LOAD QUANTITY)

FIG. 2B

FC REQUIRED GENERATED
POWER QUANTITY
(LOAD QUANTITY)

FIG. 2C

FC REQUIRED GENERATED
POWER QUANTITY
(LOAD QUANTITY)

FIG. 3

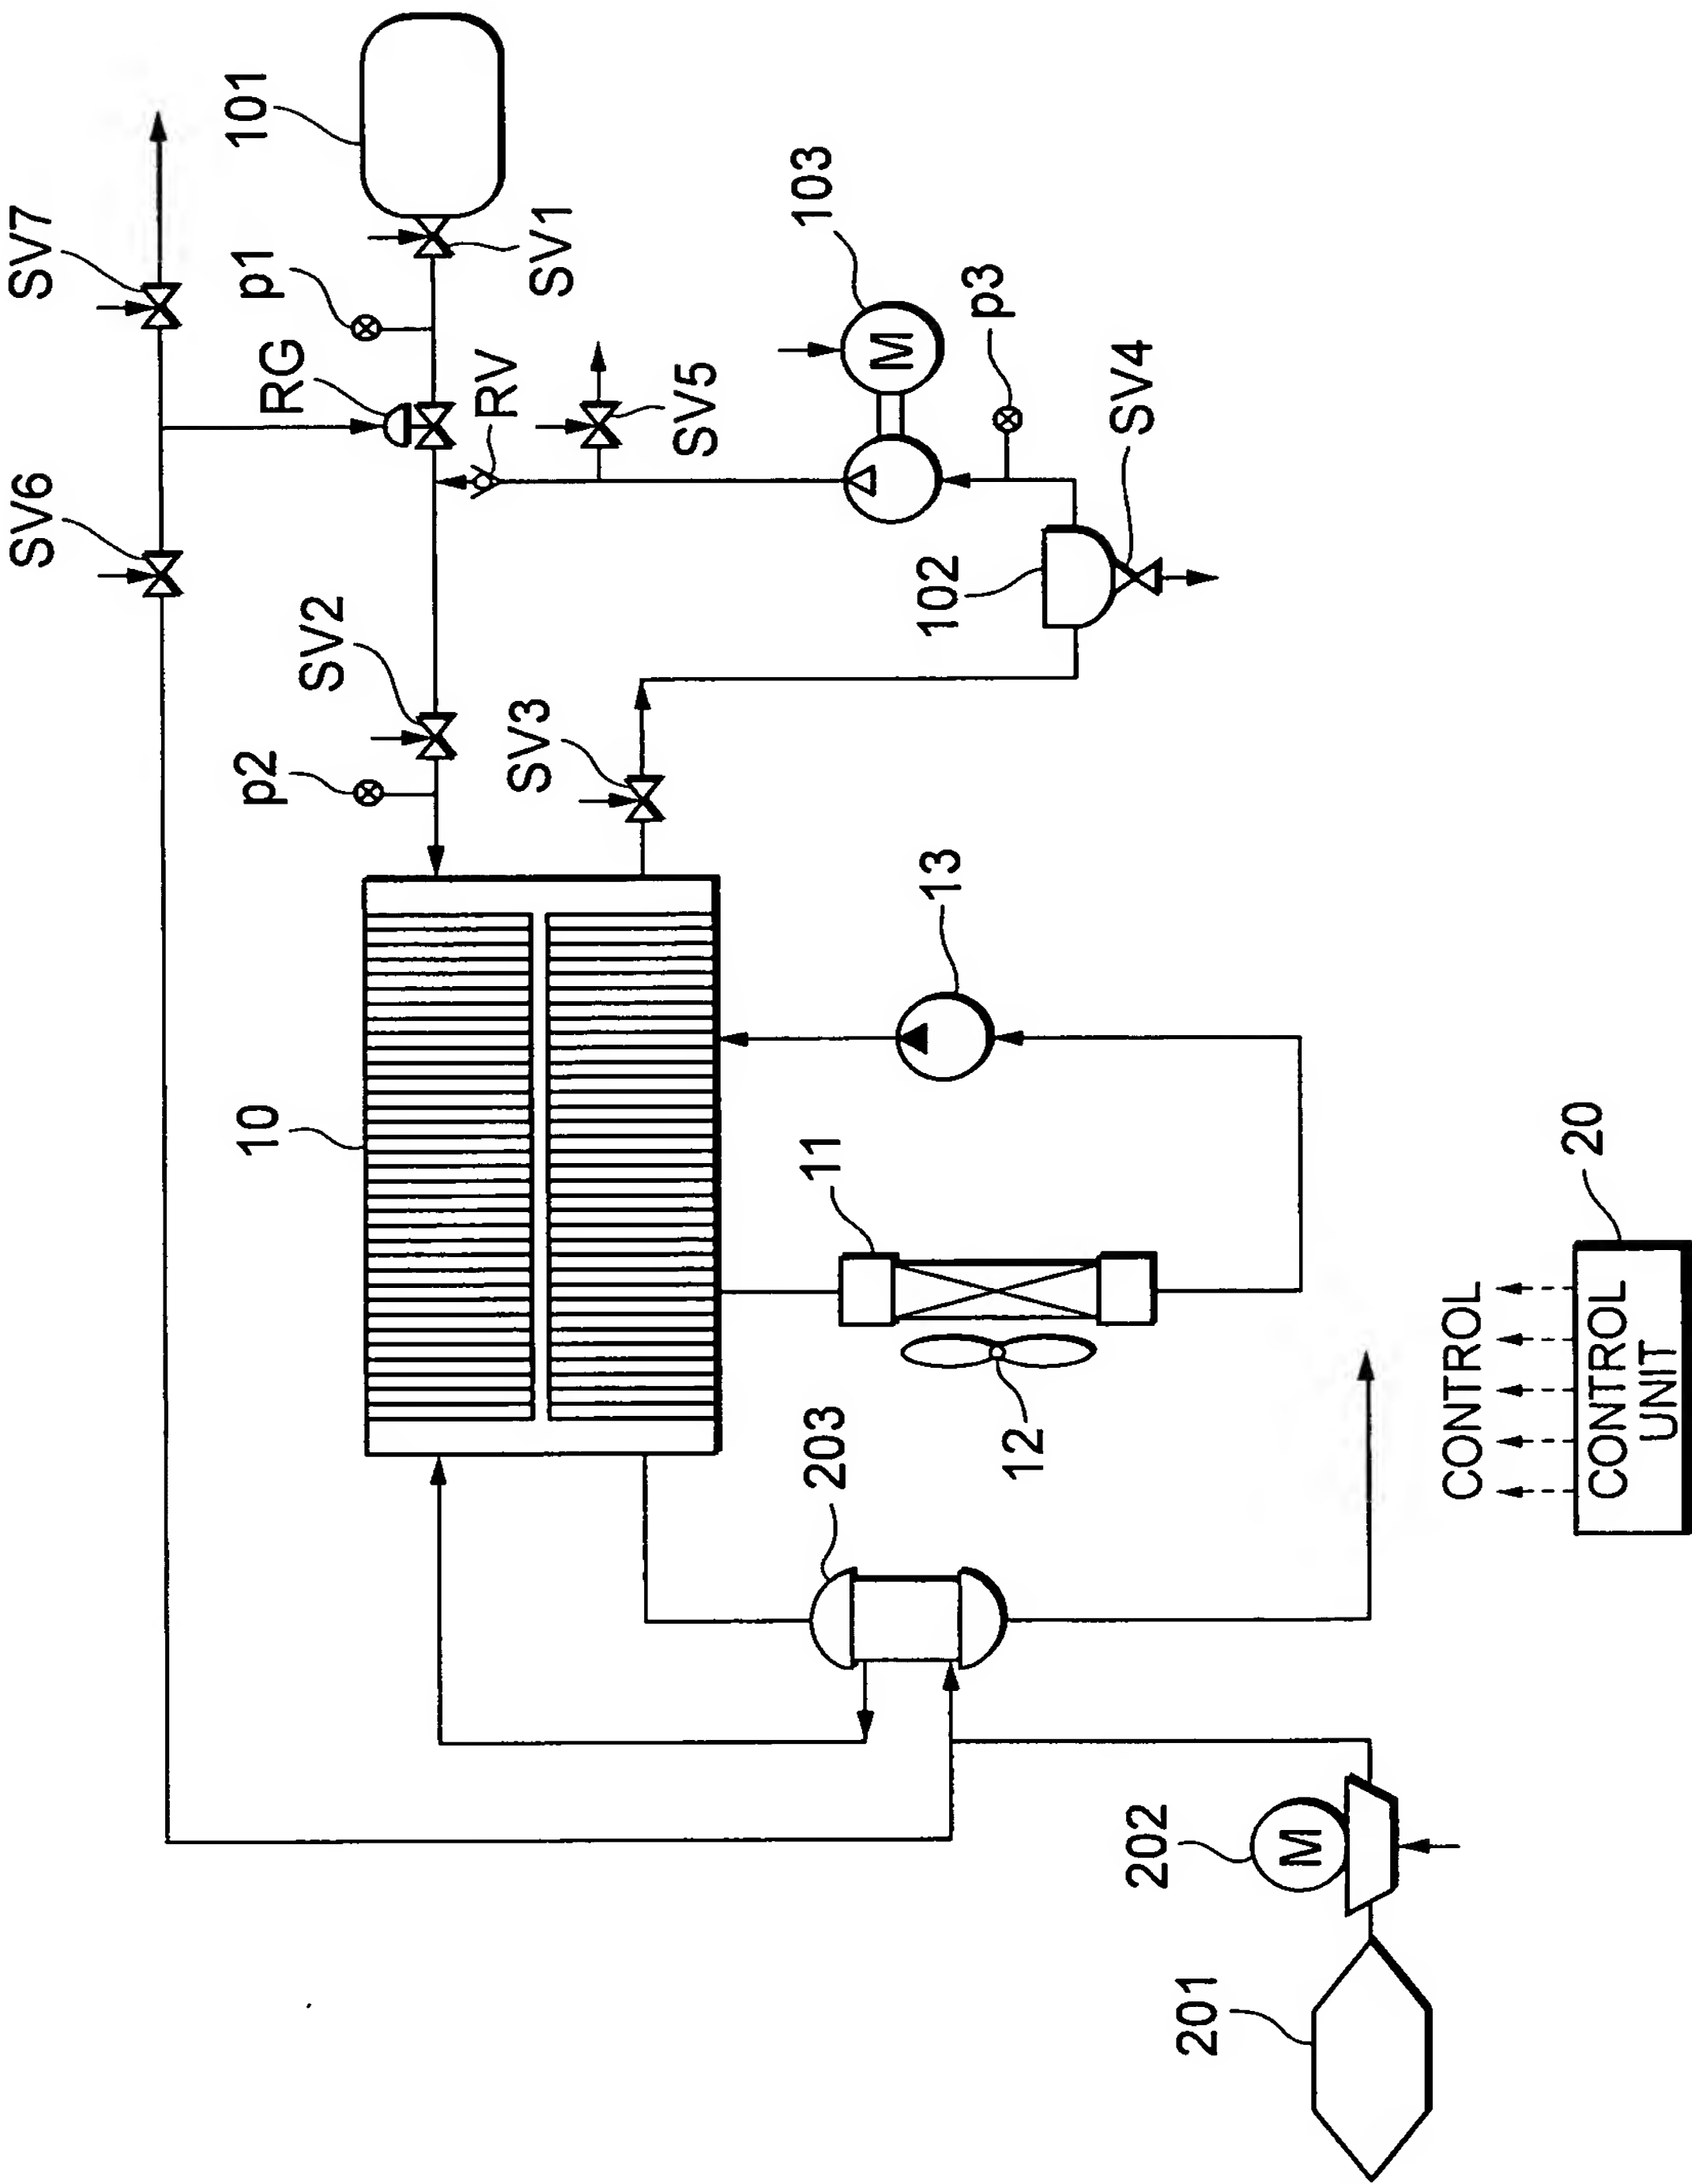


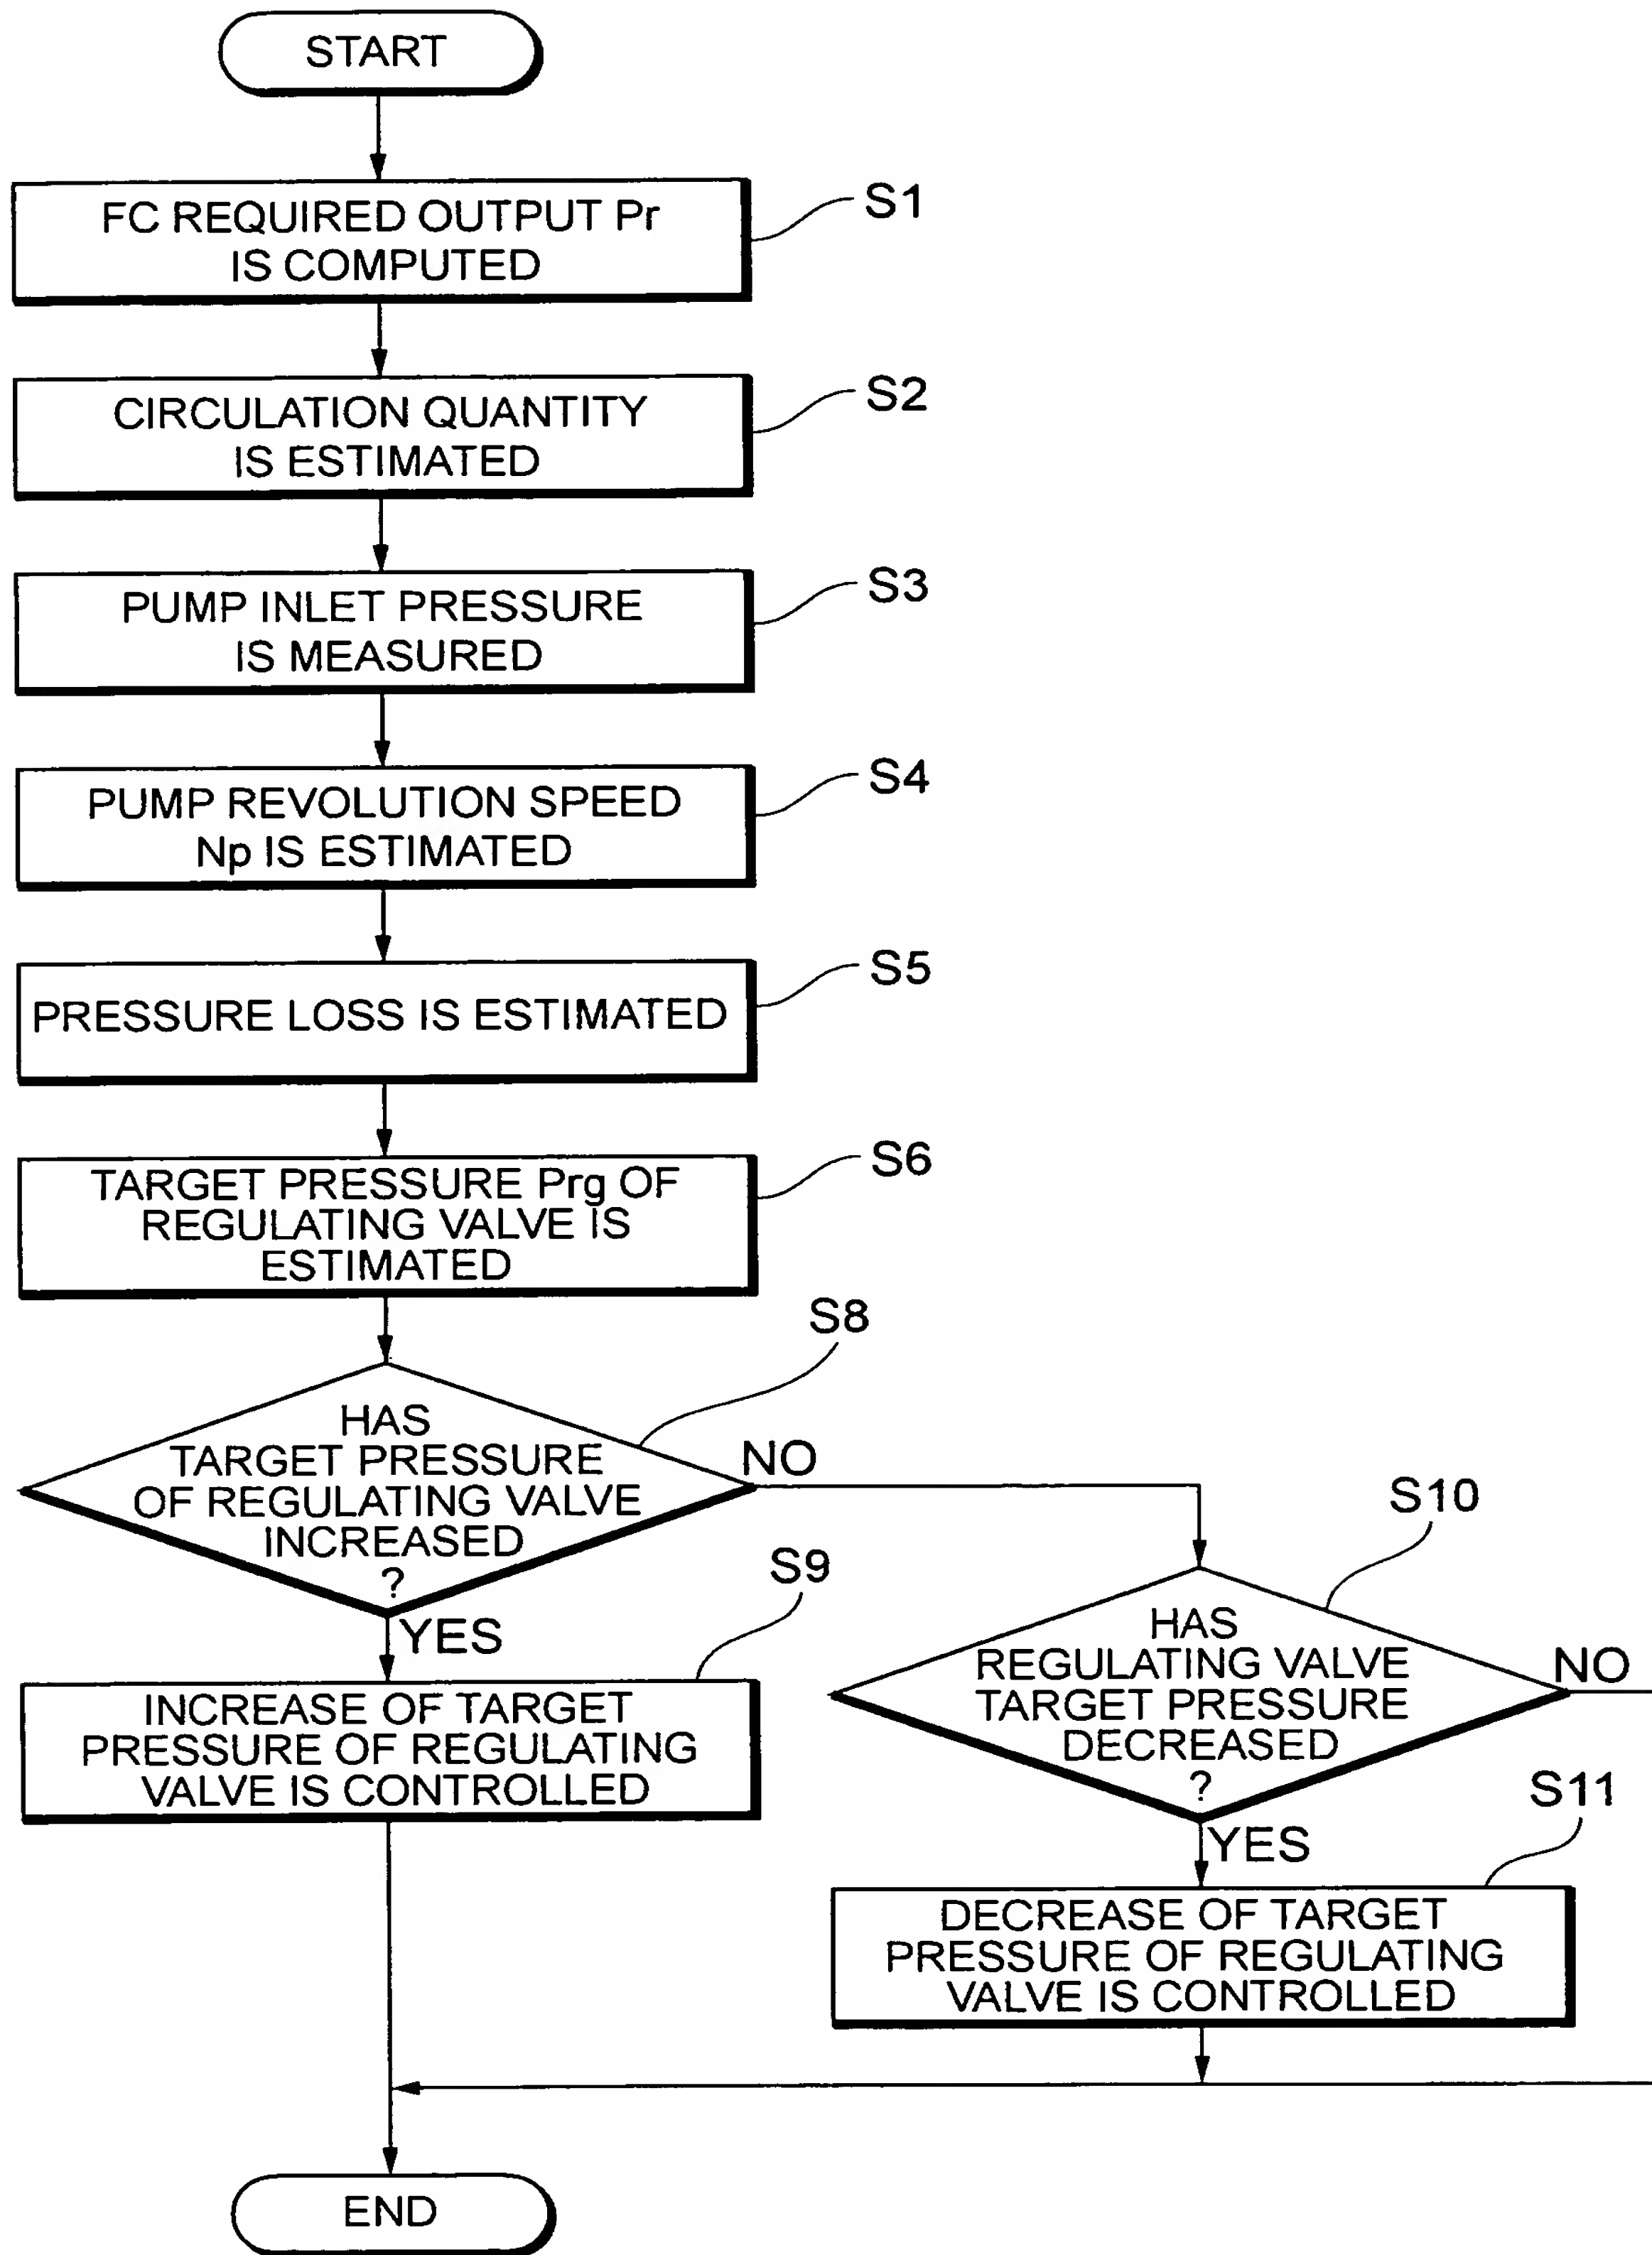
FIG.4

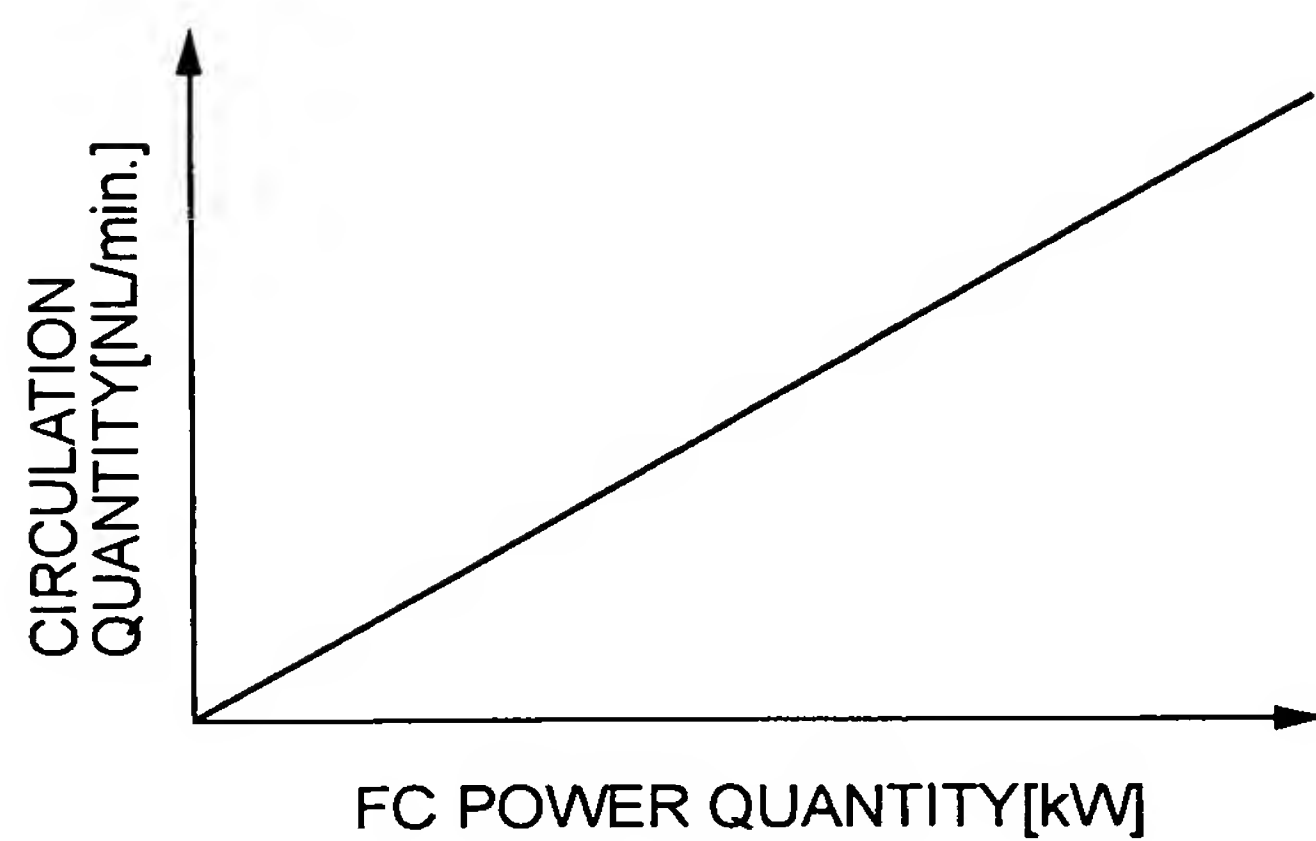
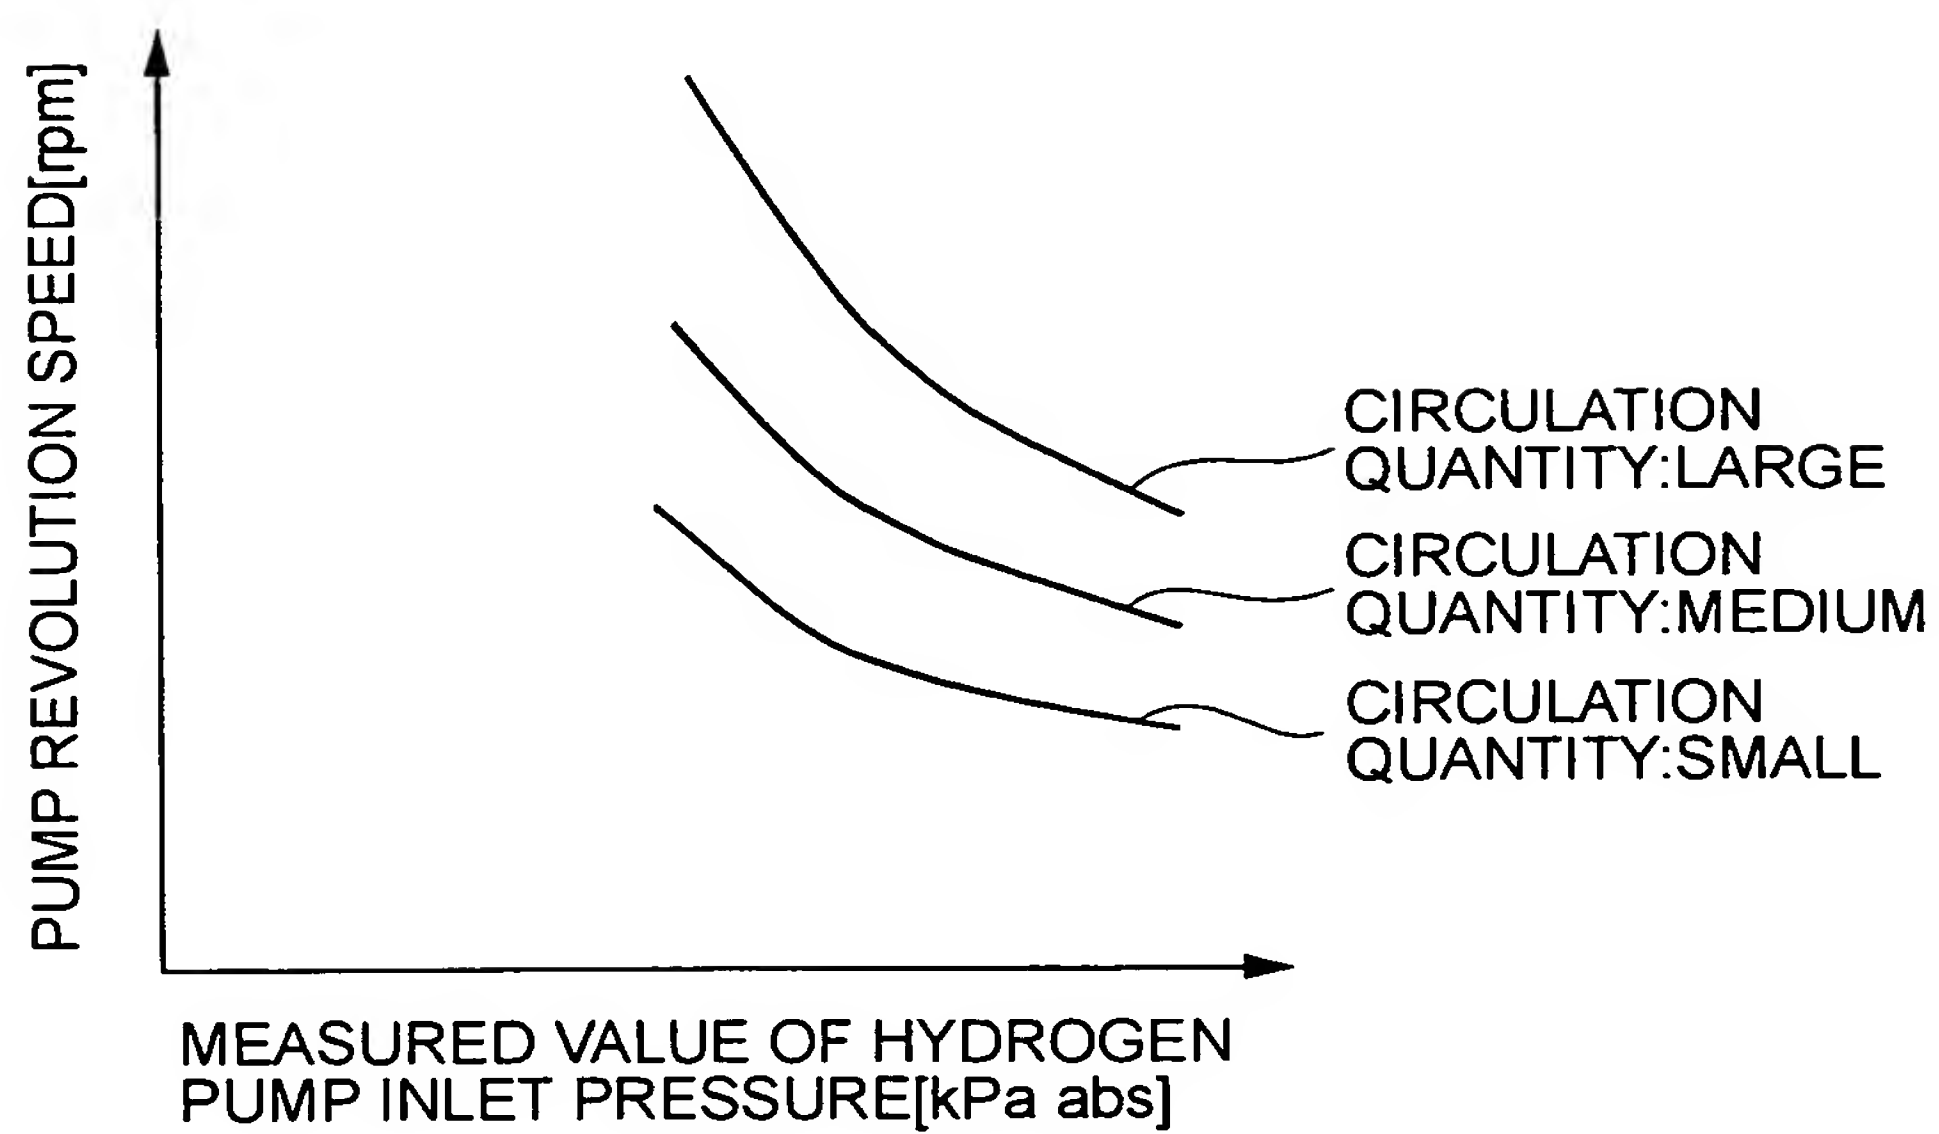
FIG. 5**FIG. 6**

FIG.7

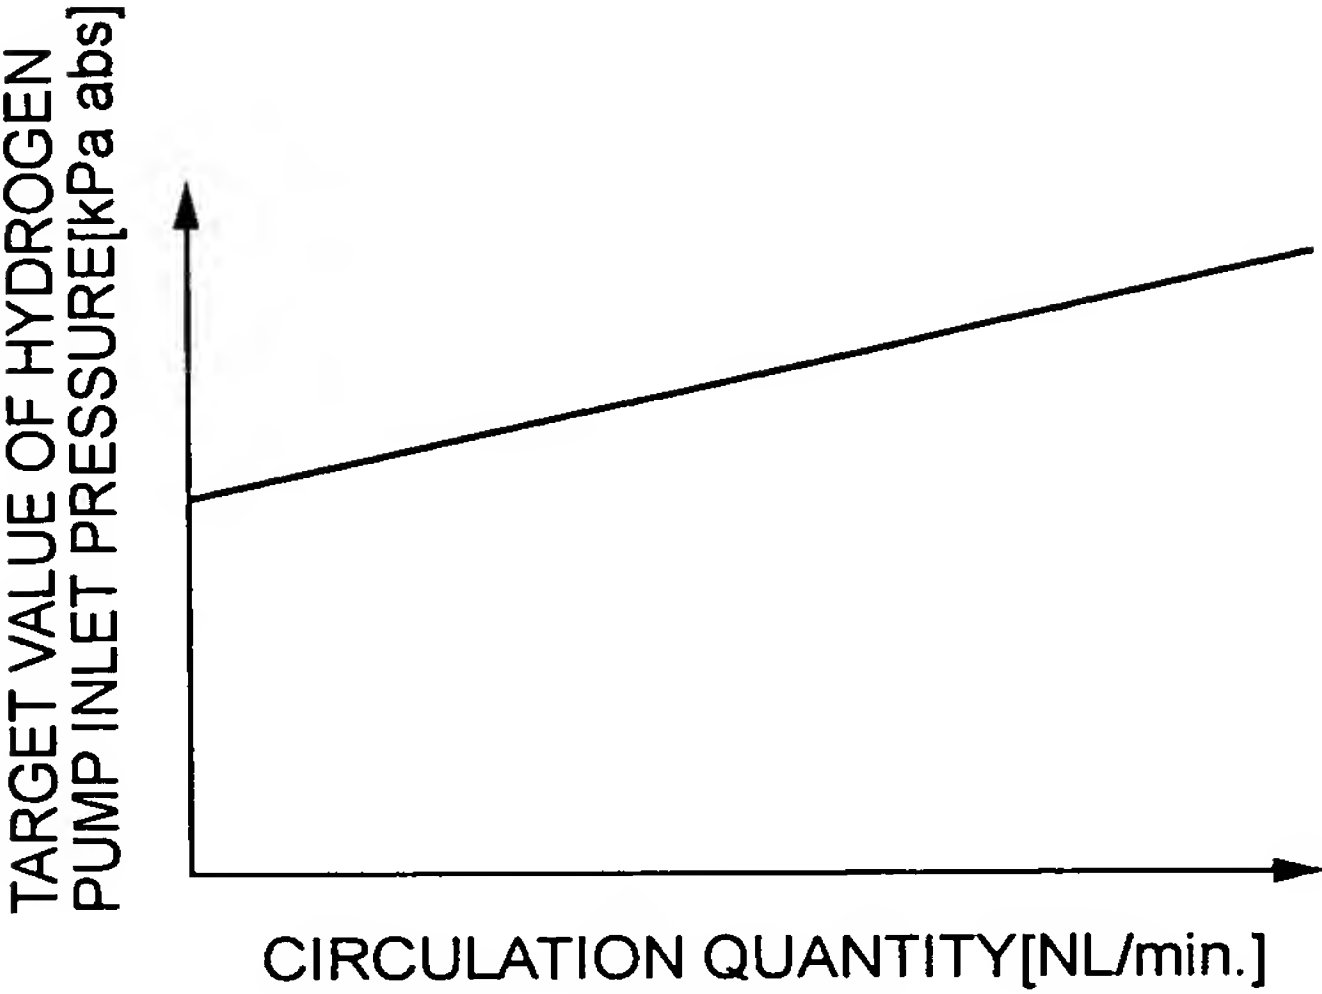


FIG.8

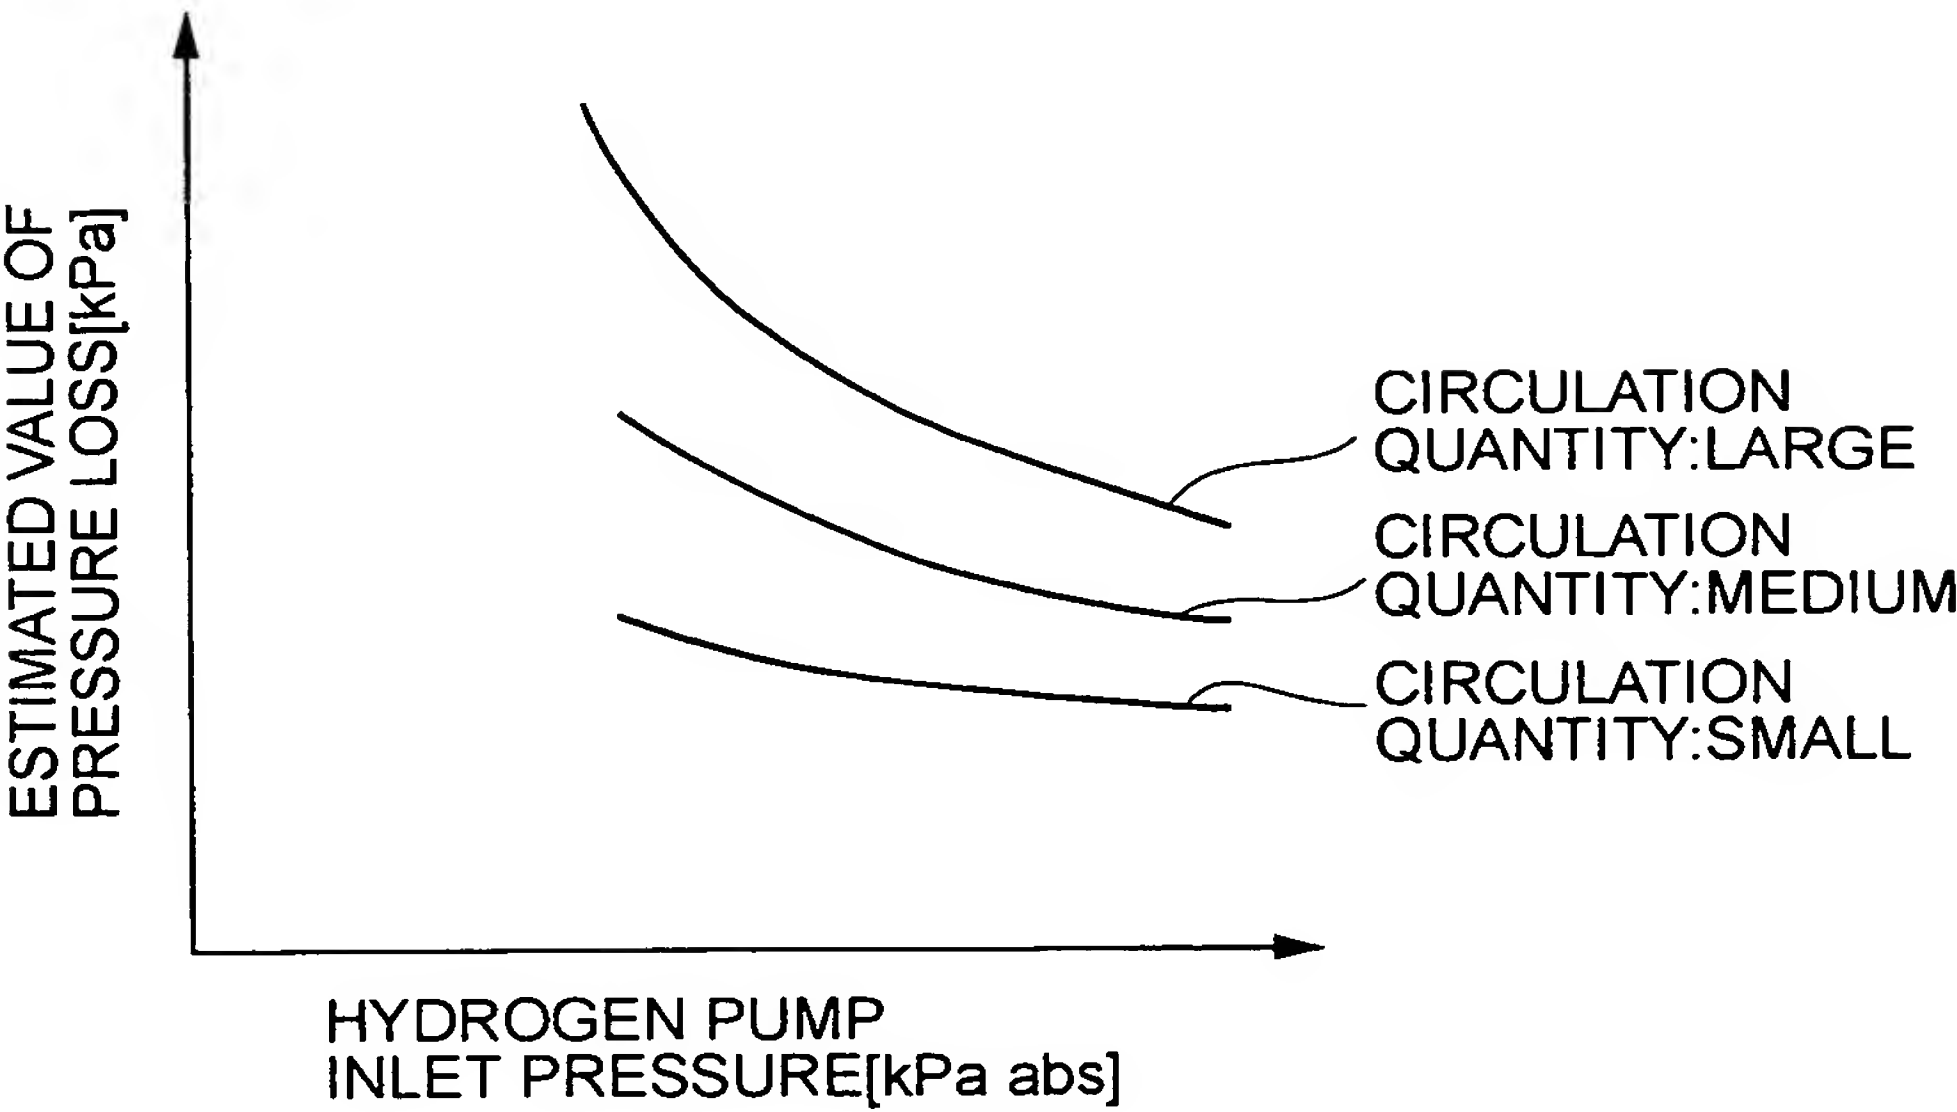


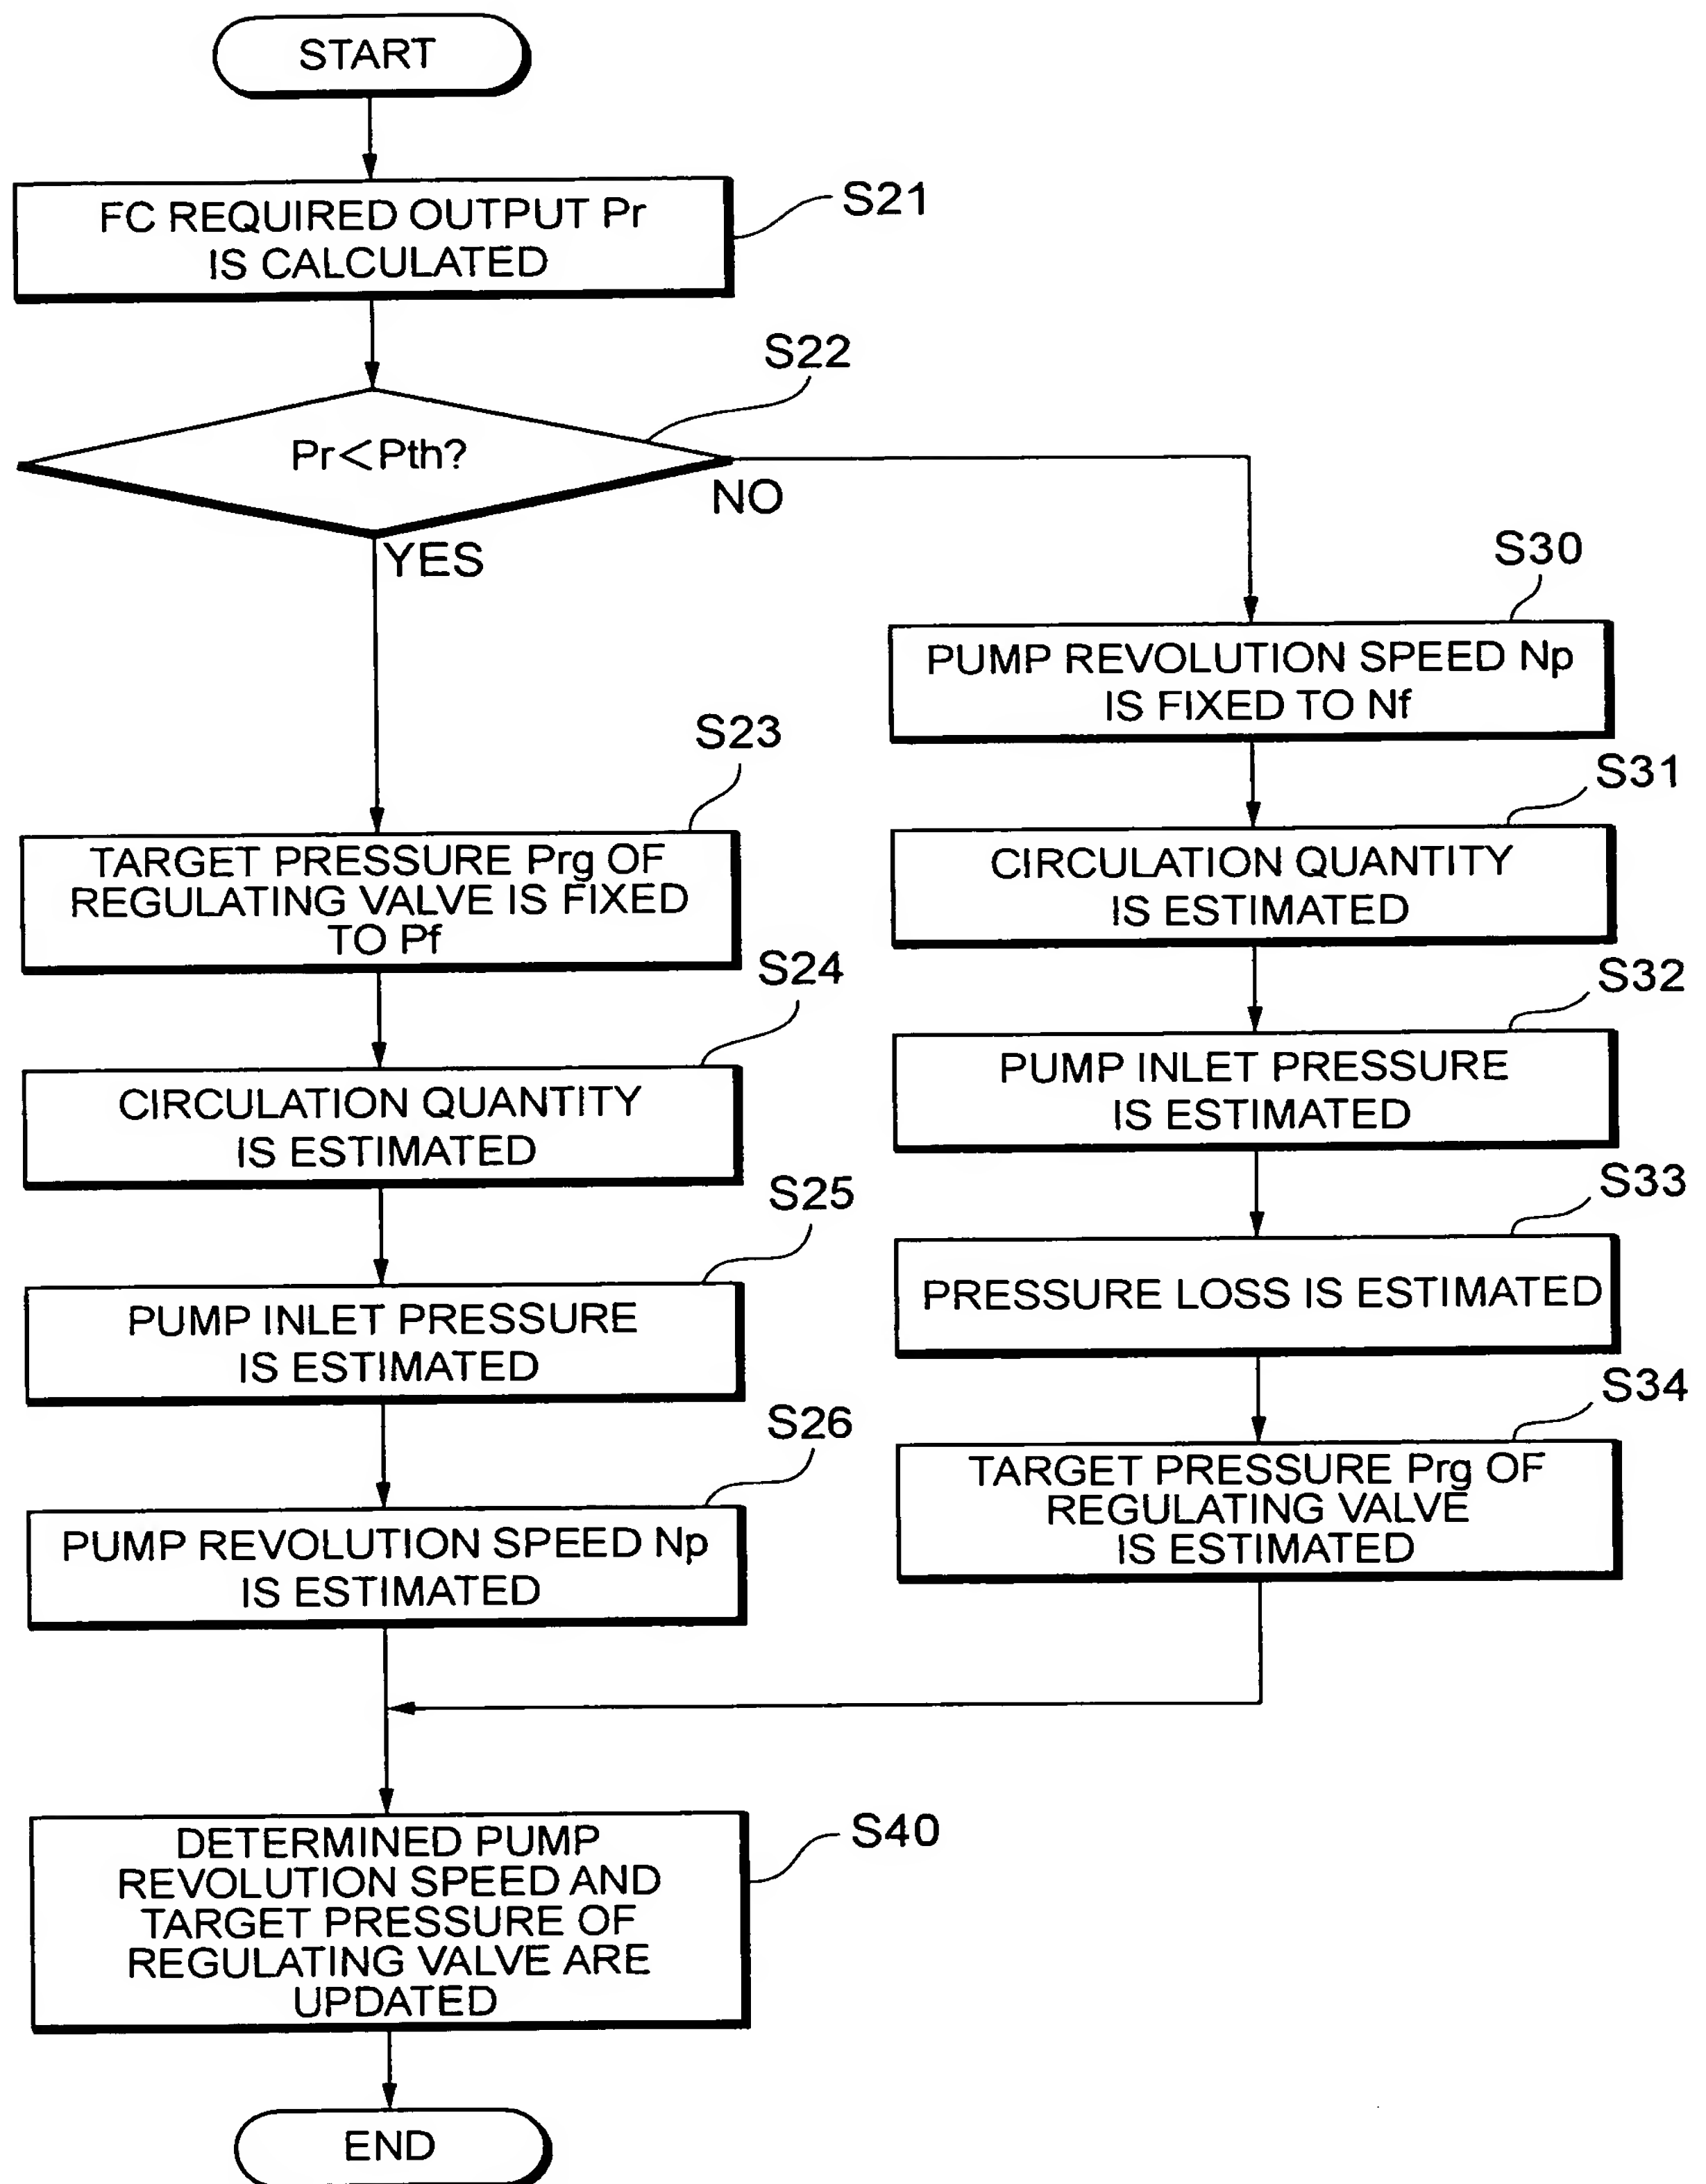
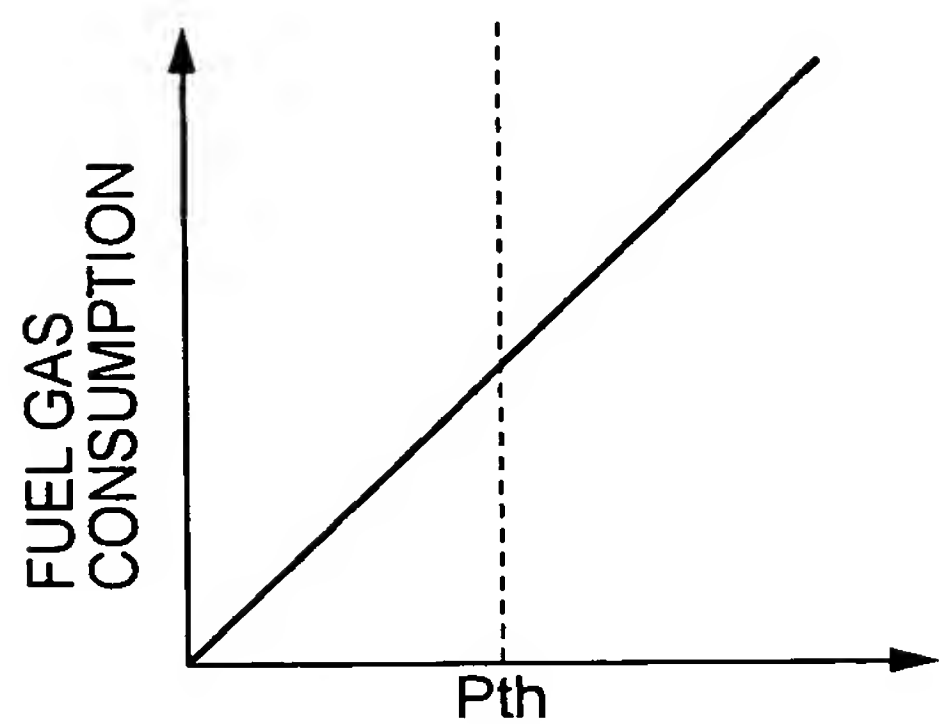
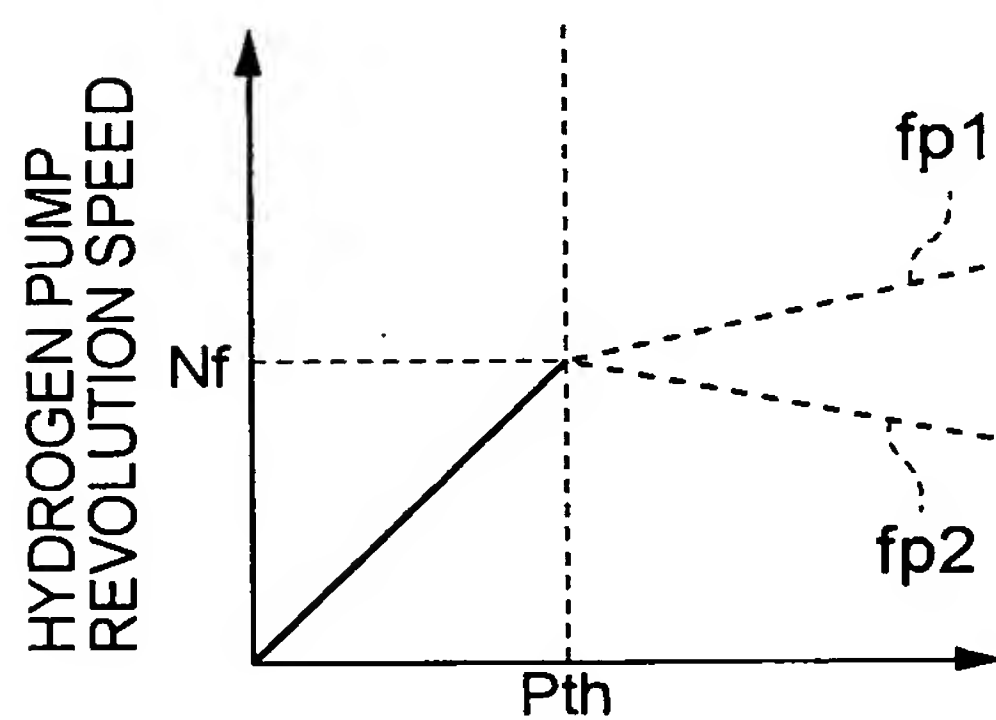
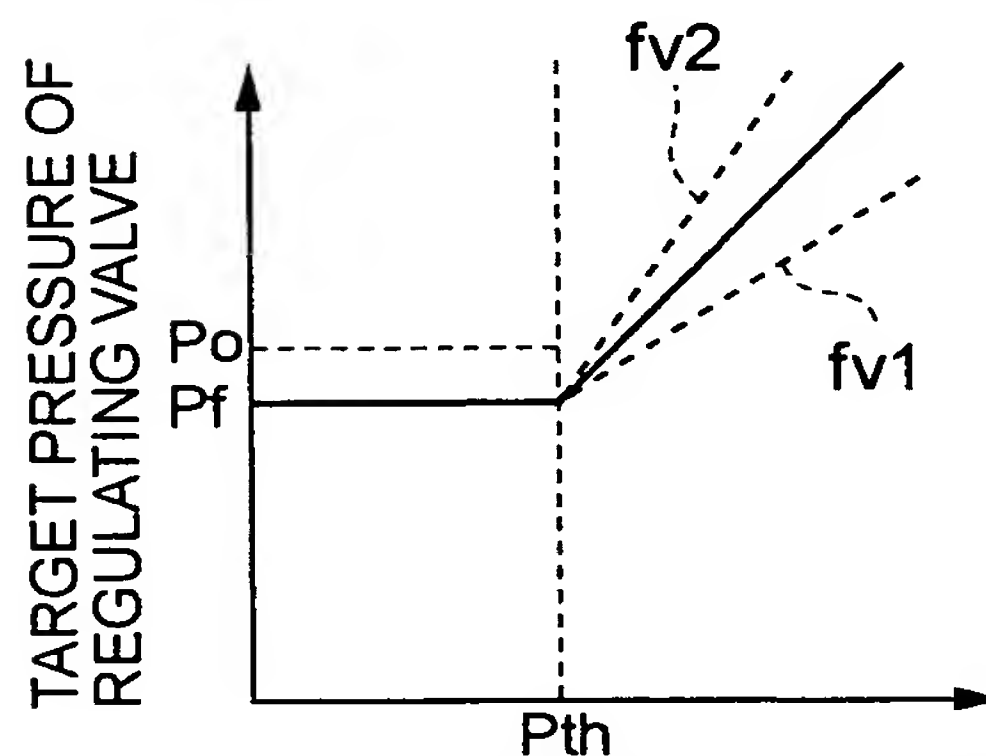
FIG. 9

FIG. 10A

FC REQUIRED GENERATED
POWER QUANTITY
(LOAD QUANTITY)

FIG. 10B

FC REQUIRED GENERATED
POWER QUANTITY
(LOAD QUANTITY)

FIG. 10C

FC REQUIRED GENERATED
POWER QUANTITY
(LOAD QUANTITY)

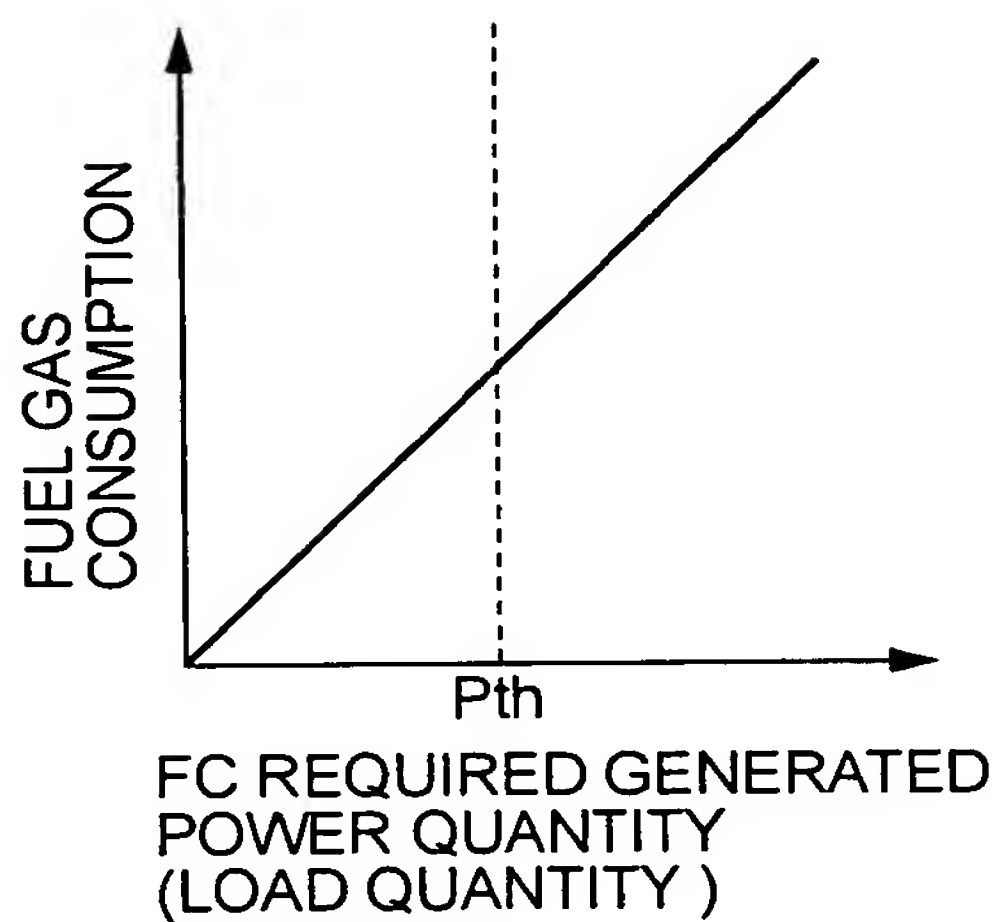
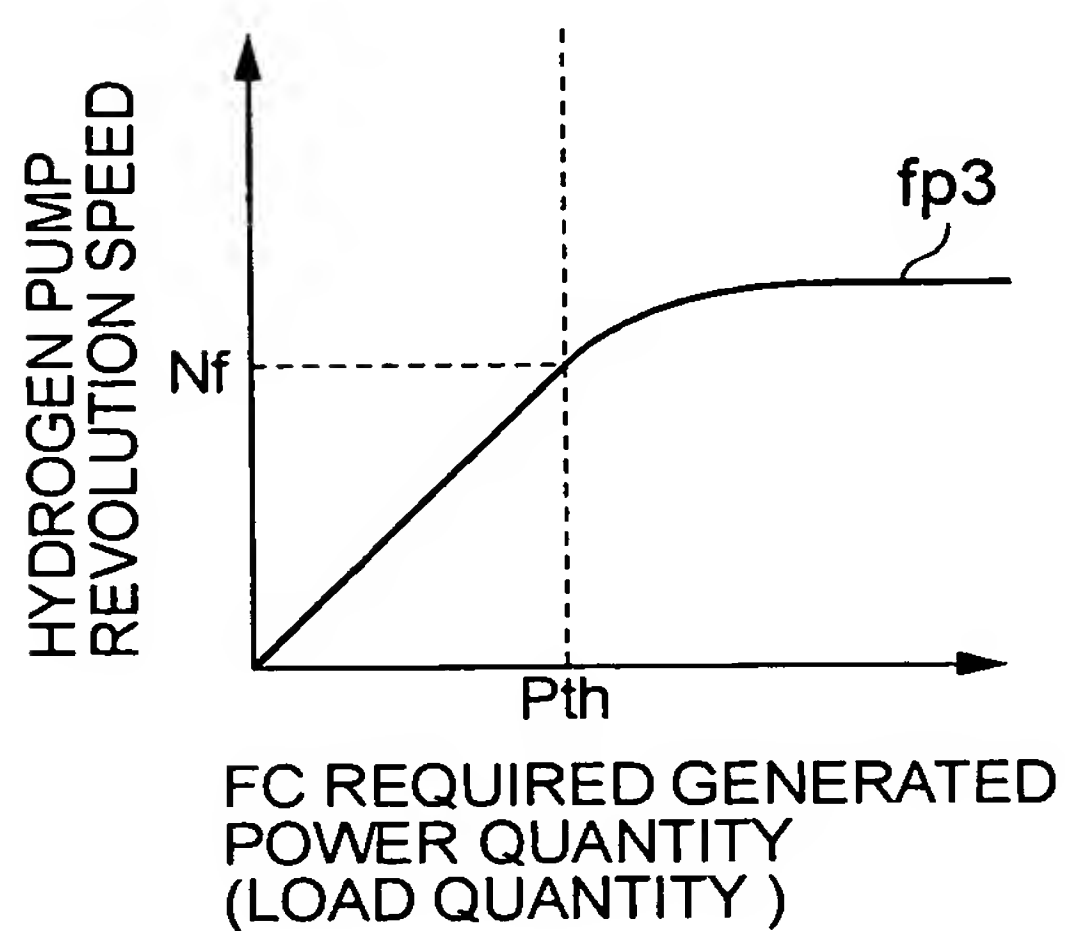
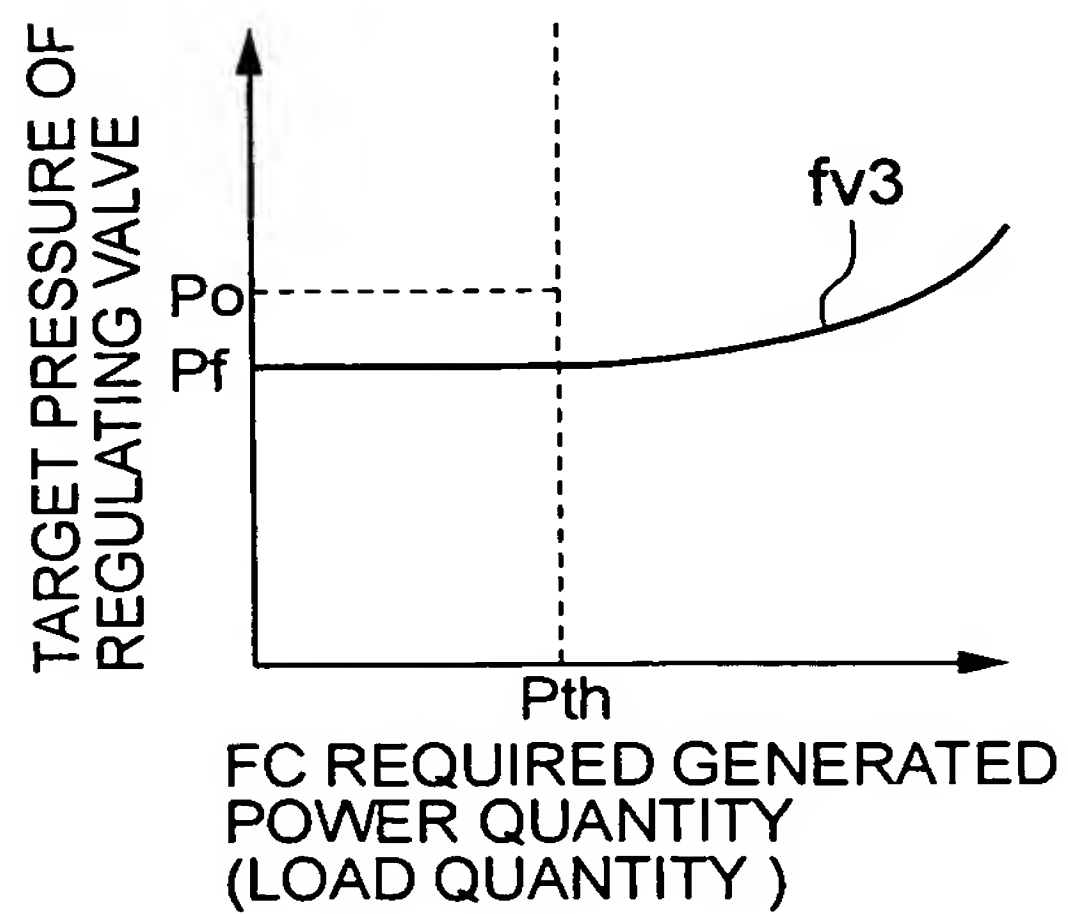
FIG. 11A**FIG. 11B****FIG. 11C**

FIG.12

